


JR. GAUGE _____
 FLOAT @ 45°

NOTE: P.O.L. V.R. _____
 FILLER, OUTAGE
 OMITTED FROM
 THIS VIEW FOR CLARITY

LAYOUT DIMENSIONS PER:
 UNIVERSAL _____ = SK-2617 REV. II
 CALIFORNIA STD. - □ = PA-432-A
 NEVADA STD. - ---- □ = PA-433-A

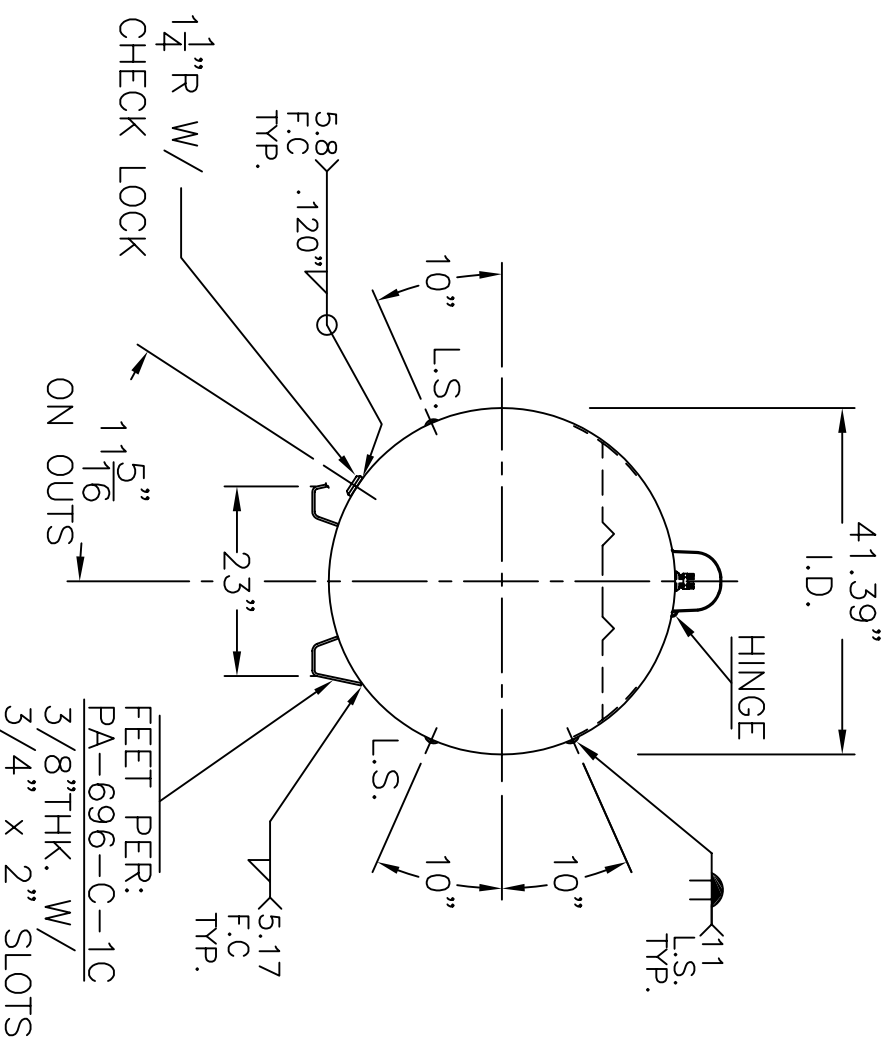

GENERAL NOTES

1. SHELL: .289" SA-455
2. HEADS: .245" SA-455 2:1 S.E.
JOGGLE
3. X-RAY: RT-4 SPOT L.S. & G.S.
4. STRESS REL., NO
5. CORR. ALLOW: NONE
6. ASME SEC. VIII DIV. 1, 2007 ADD 2009
7. M.A.W.P. 250 PSIG. @ 200 °F
M.D.M.T. -20 °F @ 250 PSIG.
8. HYDRO: 327 PSIG. MIN.
9. GAL: 1150
10. EMPTY WT: 2470# APPROX.
11. DEHYDRATE INSIDE
12. SURFACE AREA: 194.1 SQ. FT.
13. C.F.M. REQ'D. 4033

P-1150	REV. 12-28-09
	DATE: 3-5-99
FOR: HANSON STANDARD	
MODEL No. 1150	
HORIZ. PROPANE TANK	
BY: J.G.	
SCALE: 1/2"=12"	
ROY E. HANSON JR. MFG.	
1600 E. WASHINGTON BLVD. LOS ANGELES, CA 90021	